


HEALTH AND SANITATION CERTIFICATE

Certified that Kendriya Vidyalaya Payyanur ,Edat Kannur Dt 670327 owned by the The Principal Kendriya Vidyalaya Payyanur,Edat has complied with the conditions pertaining to health and sanitation of the vidyalaya.This certificate is issued with effect from 29.06.2021 for a period of one year in accordance with the rules

Sign:



Name of the officer: DR - KAVISHA K.

Designation: ASSISTANT SURNAME NAMBOL
OFFICER (C)

Office address: FHC KUNHIMANGALAM

Date: 29.6.2021

SEAL



MEDICAL OFFICER
FAMILY HEALTH CENTRE
KUNHIMANGALAM



Self attested
David

PRINCIPAL / प्राचार्य
KENDRIYA VIDYALAYA/केन्द्रीय विद्यालय
PAYYANUR, P. O. EDAT, KANNUR DIST.
कन्नूर जिला, ओ. एडाट्ट, कन्नूर जिला
PIN: 670 327, PH: 0497 2805063



KERALA WATER AUTHORITY
QUALITY CONTROL DISTRICT LAB, THANA, KANNUR
WATER ANALYSIS REPORT



TC-9558

Tele phone No : 0497 2704380
email : kwagckabkannur@gmail.com

ULR-TC955821000000183F

Report No - KWA/QA/R/2/183/1/22(E)/92	Date : 28.06.2021
Customer Name and Address	: 24.06.2021
The Principal Kendriya Vidyalaya, Payyannur Forwarded by the Health Inspector, PHC, Kunhimangalam (Sample No. 07/2021)	1. Date of receipt
	2. Sampling done by
	3. Sample Code
	4. Source of Sample
	5. Sample quantity
	6. Test performing dates
From : 24/06/2021	To : 25/06/2021

SI No	Characteristics	Unit	Test Method	Acceptable limits as per IS 10500-2012	Result
1	Taste		IS 3025 (Part 8)	Agreeable	-
2	Colour	HAZEN	IS 3025 (part 04) -1983 (Reaffirmed 2017)	5	BDL
3	Odour		IS 3025 (part 5) -2018	Agreeable	A
4	Turbidity	(NTU)	IS 3025 (part 10) -1984 (Reaffirmed 2017)	1	0.93
5	pH		IS 3025 (part 11) -1983 (Reaffirmed 2017)	6.5 to 8.5	7.95
6	Total Alkalinity (as CaCO ₃)	(mg/litre)	IS 3025 (part 23) -1986 (Reaffirmed 2019)	200	52.5
7	Total Dissolved Solids (TDS)	(mg/litre)	IS 3025 (part 16) -1984 (Reaffirmed 2017)	500	110.60
8	Total Hardness (as CaCO ₃)	(mg/litre)	IS 3025 (part 21) -2009 (Reaffirmed 2019)	200	58.00
9	Calcium (as Ca)	(mg/litre)	IS 3025 (part 40) -1991 (Reaffirmed 2019)	75	12.83
10	Magnesium (as Mg)	(mg/litre)	IS 3025 (part 46) -1994 (Reaffirmed 2019)	30	6.32
11	Chloride (as Cl)	(mg/litre)	IS 3025 (part 32) -1988 (Reaffirmed 2019)	250	8.08


Remarks: Tested parameters are within limit.

The results stated above related only to the sample(s) submitted for testing. This test certificate shall not be reproduced except in full with the written approval of the laboratory

Self attested

PRINCIPAL/प्राचार्य
KENDRIYA VIDYALAYA/केन्द्रीय विद्यालय
PAYYANNUR, P. O. EDAT, KANNUR DIST.
പയ്യന്നൂർ, പി. ഓ. എ. ടാ. കണ്ണൂർ ജില്ല
PIN: 670 327, PH: 0497 2805063

Authorised By

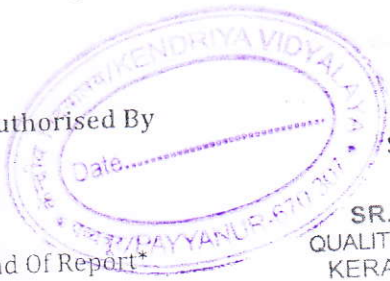

Rekha V K
Rekha V K

Sr. Sanitary Chemist

SR. SANITARY CHEMIST
QUALITY CONTROL REGIONAL LAB
KERALA WATER AUTHORITY
KANNUR-12
Rev No: 001
01.06.2021



KERALA WATER AUTHORITY
QUALITY CONTROL DISTRICT LAB, THANA, KANNUR
WATER ANALYSIS REPORT

Tele phone No : 0497 2704380
email : kwaqcckabkannur@gmail.com

Report No - KWA/QA/R/2/183/J/22(E)/92	Date : 28.06.2021	
Customer Name and Address	: 24.06.2021	
The Principal Kendriya Vidyalaya, Payyannur Forwarded by the Health Inspector, PHC, Kunhimangalam (Sample No. 07/2021)	1. Date of receipt	: 24.06.2021
	2. Sampling done by	Sampling done by Party
	3. Sample Code	13/21 (100)
	4. Source of Sample	: Open well (Sealed)
	5. Sample quantity	: 1 lit
	6. Test performing dates	Date: 24.06.2021 To: 25/06/2021

Sl No	Characteristics	Unit	Test Method	Acceptable limits as per IS 10500-2012	Result
1	Electrical Conductivity at 25°C	(micro mhos/cm)	IS 3025 (part 14) -2013 (Reaffirmed 2019)		117.40
2	Acidity	(mg/litre)	IS 3025 (part 22) -1986 (Reaffirmed 2019)		5.0
3	Sulphate (as SO ₄)	(mg/litre)	APHA23rd Edition (Turbidimetric method)	200	14.68
4	Fluoride (as F)	(mg/litre)	IS 3025 (part 60) -2008 (Reaffirmed 2013)	1	BDL
5	Iron (as Fe)	(mg/litre)	IS 3025 (part 53) -2003 (Reaffirmed 2014)	1	BDL
6	Nitrate (as NO ₃)	(mg/litre)	APHA23rd Edition (UV Screening method)	45	BDL

Remarks: Tested parameters are within limit

The results stated above related only to the sample(s) submitted for testing. This test certificate shall not be reproduced except in full without the written approval of the laboratory

Self attested

PRINCIPAL / प्राचार्य
KENDRIYA VIDYALAYA/केन्द्रीय विद्यालय
PAYYANUR, P. O. EDAT, KANNUR DIST.
പയ്യന്നൂർ, പി. ഓ. ട്റാട്ട്, കണ്ണൂർ ജില്ല
PIN: 670 327, PH: 0497 2805063

Authorised By



Rekha. V.K.

Sr. Sanitary Chemist

SR. SANITARY CHEMIST
QUALITY CONTROL REGIONAL LAB
KERALA WATER AUTHORITY
KANNUR-07.06.2021

* End Of Report*